




EMERGENCY ESCAPE AND RESCUE: EXIT WINDOWS [2016 CBC 1030]

WHEN REPLACING WINDOWS, THE FOLLOWING REQUIREMENTS APPLY:

1. PERMIT IS REQUIRED
2. ALL NEW WINDOWS MUST BE DUAL GLAZED
3. NEW WINDOWS SHALL HAVE A 0.32 MAX. U-FACTOR AND 0.25 MAX SHGC
4. LEAVE NFRC LABELS ON WINDOWS FOR INSPECTION
5. 20" MINIMUM CLEAR WIDTH AND 24" MINIMUM CLEAR HEIGHT [CBC 1030.2.1]
6. 5.7 SF MIN. OPENABLE AREA EXCEPT GRADE-FLOOR OPENINGS SHALL BE 5 SQUARE FEET [CBC 1030.2]
7. BOTTOM OF CLEAR OPENING NOT MORE THAN 44" ABOVE THE FLOOR [CBC 1030.3], OR LESS THAN 24" ABOVE THE FLOOR FOR 2ND STORY [CRC 312.2.1]

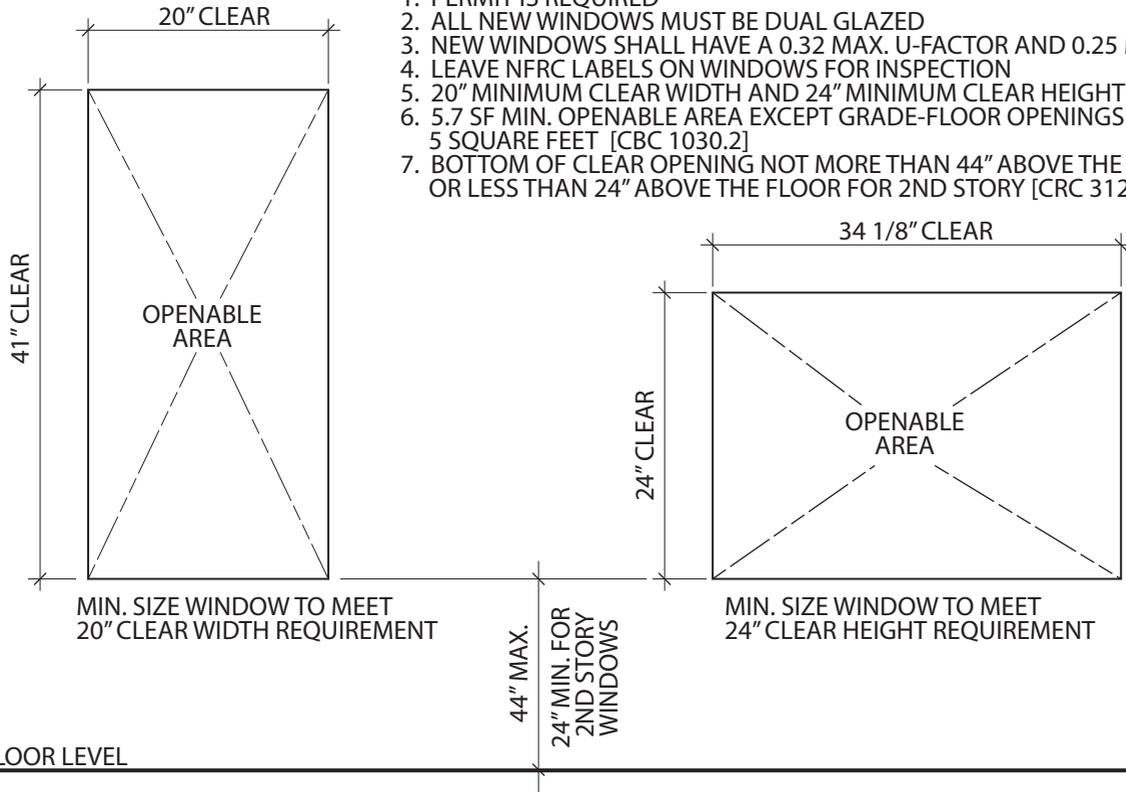

THE FOLLOWING WINDOW SIZES WILL BE THE MINIMUM ALLOWED FOR EGRESS UNLESS MANF. DATA IS SUPPLIED:

STANDARD 6'-8" HEADER HEIGHT

